


- 1 WALL LINEAR DIFFUSER IS COMING ABOVE THE TOILET REFLECTED CEILING LEVEL.
- 2 HVAC UNIT SUBMITTAL NOT AVAILABLE.
- 3 DUCT RUNNING BELOW THE REFLECTED CEILING LEVEL.
- 4 PIPE RUNNING BELOW THE REFLECTED CEILING LEVEL.
- 5 PIPE SIZE NOT AVAILABLE IN GIVEN SPRINKLER DESIGN DWG.

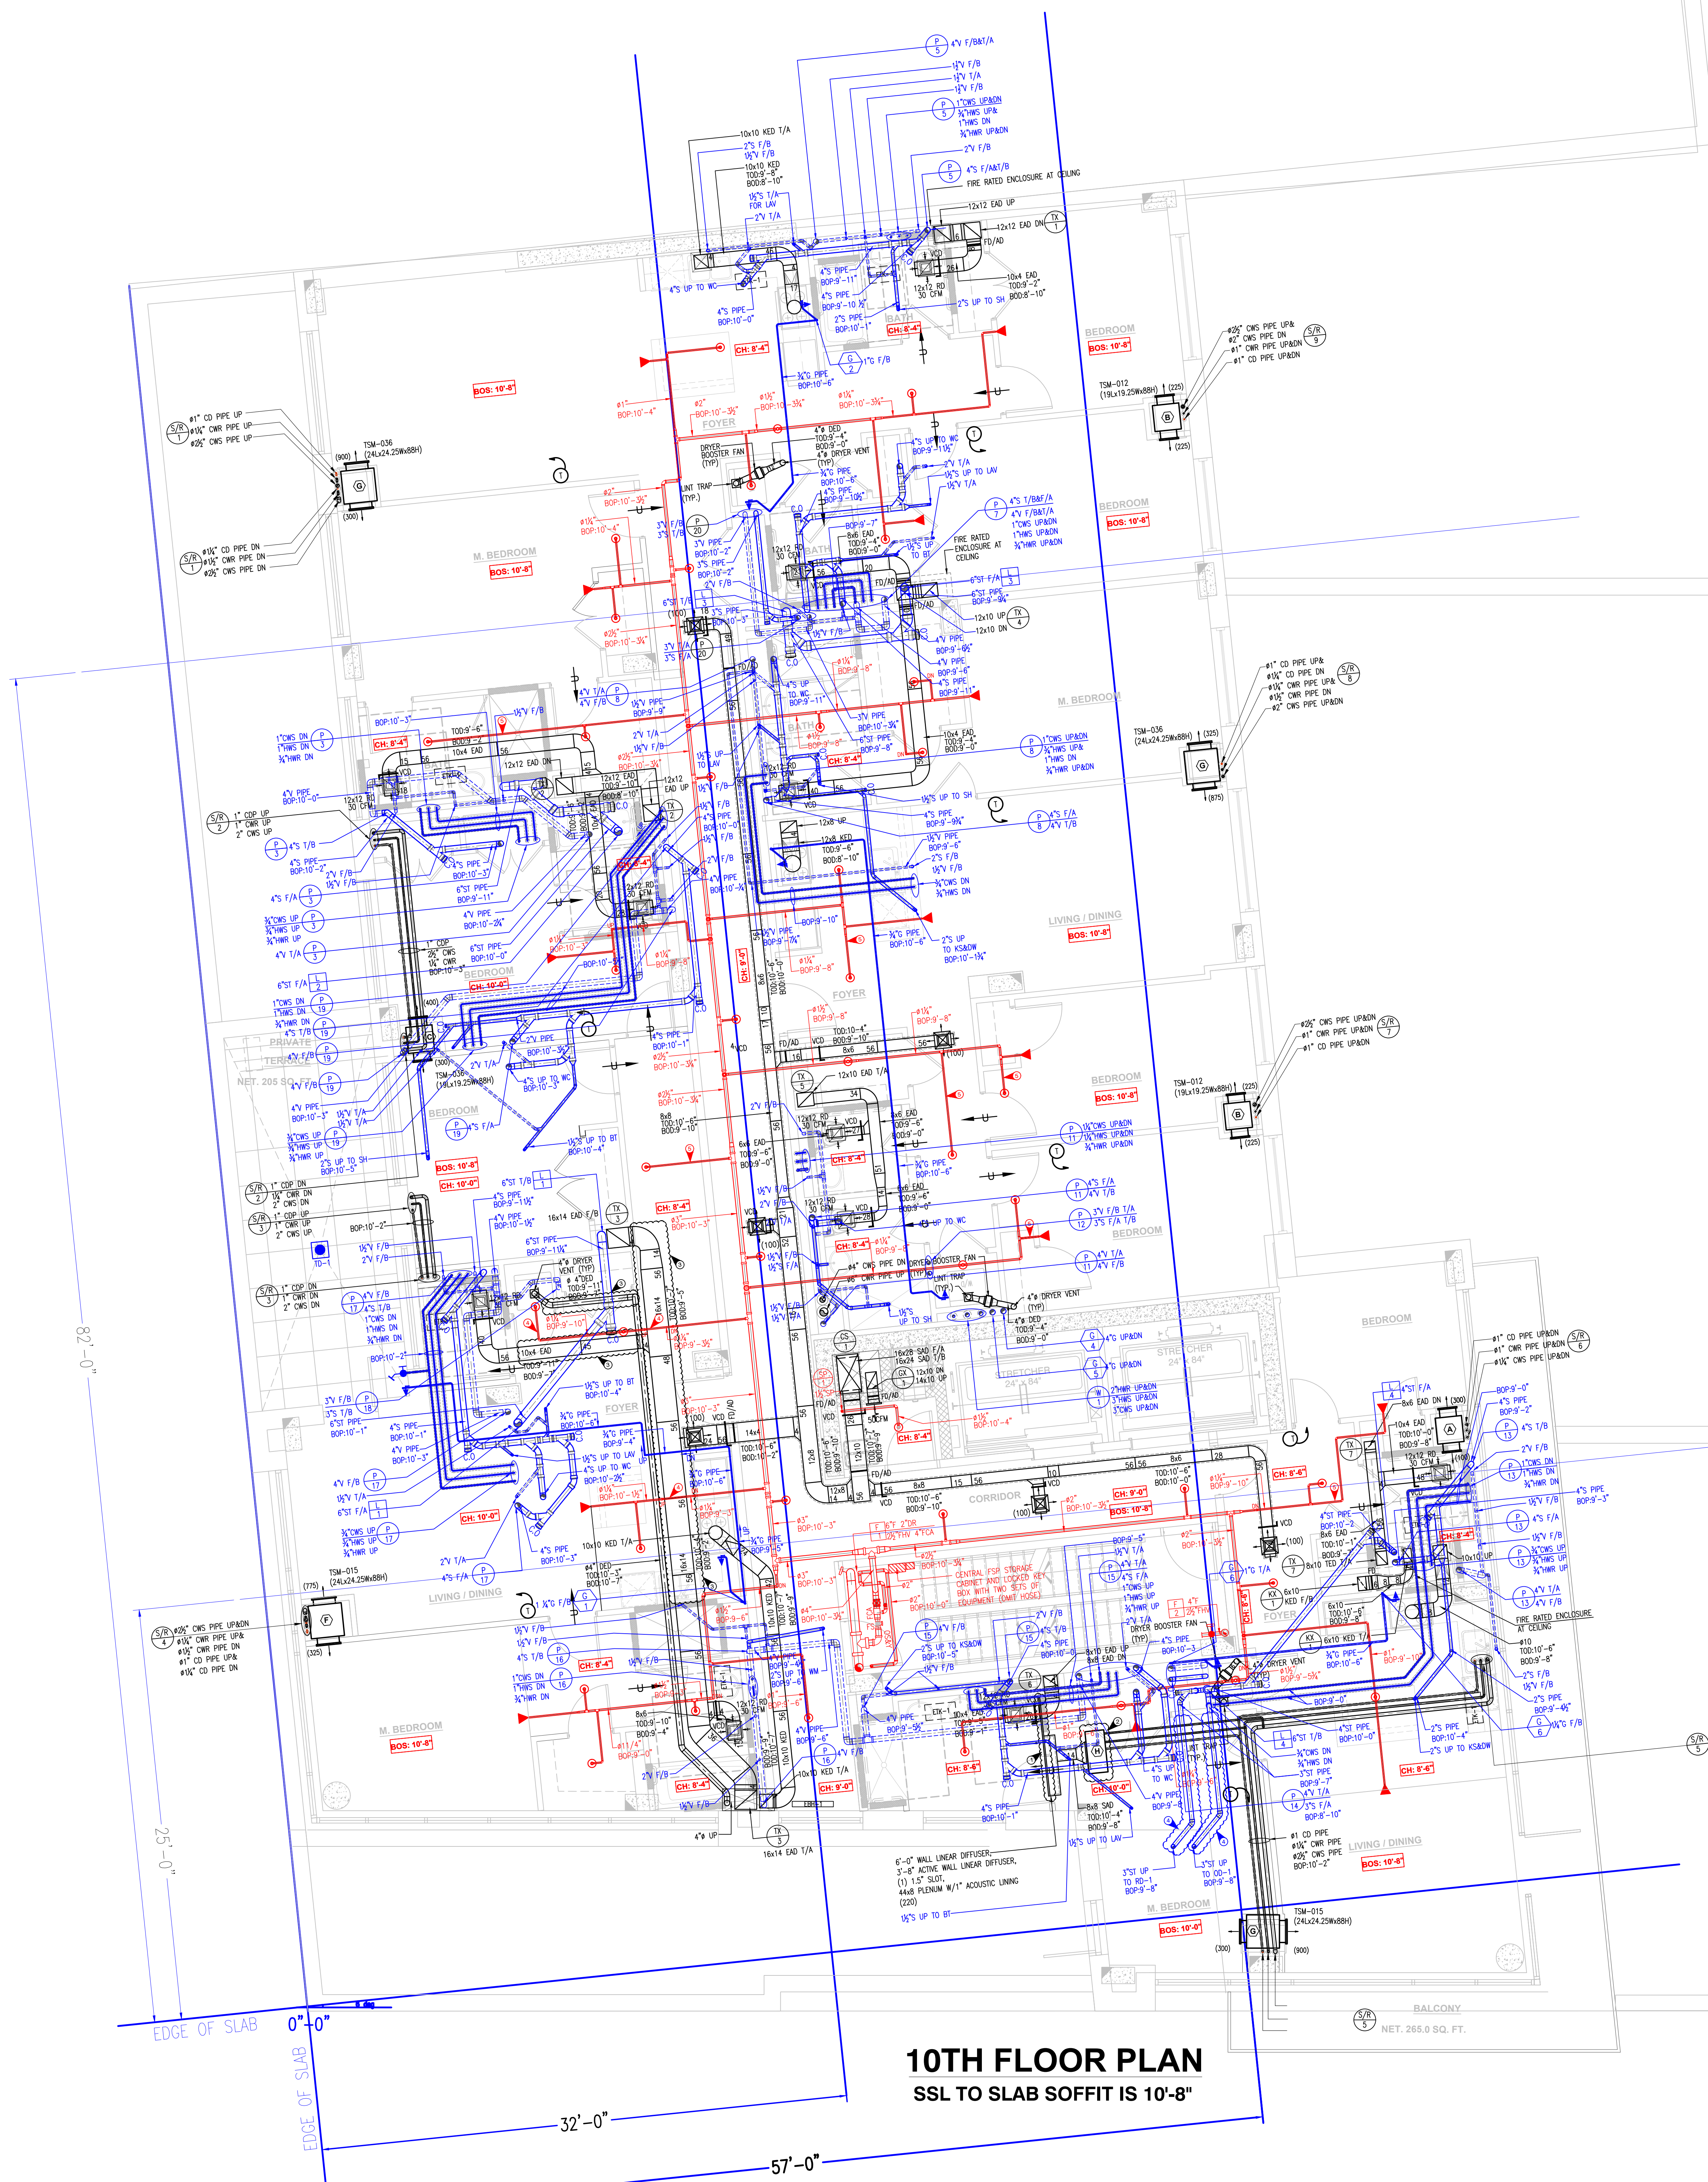

THIS DRAWING IS A PRESENTATION OF A PROPOSED LAYOUT. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY AND REVIEW PRIOR TO FINAL SUBMISSION. CADDISULTANTS IS NOT RESPONSIBLE FOR DISCREPANCY'S IN THE FIELD. ANY CORRECTIONS TO THE DRAWING IS REQUIRED BY THE CONTRACTOR TO ADVISE CADDISULTANTS BEFORE FINAL SUBMISSION & BEFORE FABRICATION OR INSTALLATION.

NO.	DATE	DESCRIPTION
1	04/20/18	UPDATED AS PER COMMENTS.

PLUMBING CONTRACTOR:
Titan Realty & Construction
 One Plaza Road
 Greenvale, New York 11548
 T. 516-348-1200 x 143
 F. 516-348-1201
 E. Nawad@titannewyork.com

DRAFTING COMPANY:
CADDISULTANTS
 Certified CAD Specialist
 All Types of Drafting
MARC HOFFMAN
 167 Allen Road
 Rockville Centre NY, 11570
 Contact: 646.641.2512
 Email: Caddisultant@yahoo.com

ADDRESS:
NEW MIXED USE DEVELOPMENT
 575 4th AVENUE
 BROOKLYN, 11215

PROJECT INFORMATION:
**10TH FLOOR
 COMBINED SERVICES LAYOUT**